



# AIR POLLUTION DISPERSION MODELING FOR DIESEL GENERATORS AT JAMIA UNIVERSITY CAMPUS, NEW DELHI, INDIA

Adil Masood

Department of civil Engineering  
Jamia Millia Islamia, New Delhi, India

Kafeel Ahmad

Department of civil Engineering  
Jamia Millia Islamia, New Delhi, India

**ABSTRACT:** The study is conducted in order to assess the contribution of pollutants from the Diesel generators running in the Jamia Millia Islamia campus. In this work, ISCST3 air pollution model was applied to simulate the air quality for 24 hourly average ground level concentrations of SO<sub>x</sub>, NO<sub>x</sub>, PM and 8 hourly average for CO at various receptor locations. Based on surveys and questionnaires, an inventory was formulated for different Gensets and their characteristics. The ISCST3 model is based on a steady-state Gaussian plume algorithm. It has been developed by USEPA for assessing air quality impact from point, area, and volume sources. Emission rates for Different pollutants have been computed using empirical formulas for Gensets based on their capacity. Pollutant emitting potential has also been computed in this study. The predicted values simulated by ISCST3 model are 11.33 μg/m<sup>3</sup> for PM<sub>10</sub>, 58.43 μg/m<sup>3</sup> for SO<sub>x</sub>, 176.50 μg/m<sup>3</sup> for NO<sub>x</sub>, and 57.02 μg/m<sup>3</sup> for CO. Both monitored and predicted values have been compared with NAAQS 2009. A pragmatic solution for curtailing the pollution load in the area has been proposed in the research which will further assist in managing the air quality scenario for the region. . Both monitored and simulated values have been compared with NAAQS 2009. A possible solution for minimizing the pollutant load in the area via Diesel Gensets has been suggested in this research which will further help in managing the air quality scenario the Study area

**Keywords:** ISCST3, Emission rate, Emission modeling

## I. INTRODUCTION

With the advent of rapid urbanization and rising air pollution load, It has become quite essential to curb the air pollution exposure by precisely assessing the air quality [6] [13]. The problem of Air pollution in Delhi has been in the spotlight for over a decade and it has now been recognized as a brainstorming issue for the whole nation [7] [14]. Over the last two decades petrol and diesel consumption have grown by 400% and 300% respectively which has led to the rise of vehicular pollution as well as pollution due to other sources like DG sets, Industries, waste incinerators[8] [15]

[16]. A typical diesel generator exhaust includes more than 40 toxic air contaminants including a variety of carcinogenic compounds like Benzene, Arsenic, Formaldehyde and Oxides of Nitrogen [9]. Emissions from diesel generators in the form of NO<sub>x</sub>, CO and Hydrocarbons chiefly contribute to the deteriorating air quality in the capital [10]. Many air quality models have been used throughout the world for air pollution dispersion that enables effective evaluation of the impacts of air pollution on urban air quality. In 2003 Gooi et al. simulated the air pollution levels using ISCST3EM model caused by inner city traffic in Malaysia, and had compared the emissions with the available national and international standards, based on their analysis they were able to assess the potential health hazards caused by the air pollution so generated [11]. A comprehensive modeling study of PM<sub>10</sub> in Treasure valley, Idaho(2011) was executed by Darko et al.. Their study utilized the services of ISCST3 model where the simulated values were found in agreement with measurements in both temporal and patterns and annual averages [12].

## II. METHODOLOGY

The main aim of this study is to model the air quality in Jamia University Campus, New Delhi, India by ISCST3 air quality modeling tool. The elevated levels of pollutant concentration due to Diesel based generators and their effects on the surrounding air quality have been studied in this research. Our study has been executed in three stages, the first stage involves assimilation of generator data i.e. generator capacity, characteristics, location, fuel consumption, unit installation. Once the data was formulated then the next stage was executed where the pollutants emission rate for NO<sub>x</sub>, SO<sub>2</sub>, CO were computed so to be further utilized in ISCST3 model. In the next stage the pollutant potential of generator based on its capacity was determined and also the emission rate for each pollutant was computed. The final stage involves inputting all the required parameters for model run and comparison of simulated data with NAAQS.



**A. AREA OF STUDY**

Jamia University being located on the south-east corner of Delhi is well connected to all key parts of the city. The university campus covers an area of almost 216 acres with a thick amount of green cover in the entire campus. The DMS latitude of the university is 28° 33' 41.9652" N and DMS longitude is 77° 16' 52.5288" E, lying in the UTM zone 43R the campus has an elevation of 215m. Based on number of source apportionment studies done it has been observed that diesel based generators contribute heavily in the deteriorating air quality of the campus. A total of 40 generators of varying capacity have been installed at pertinent locations having a total capacity of 8650.5 KVA.

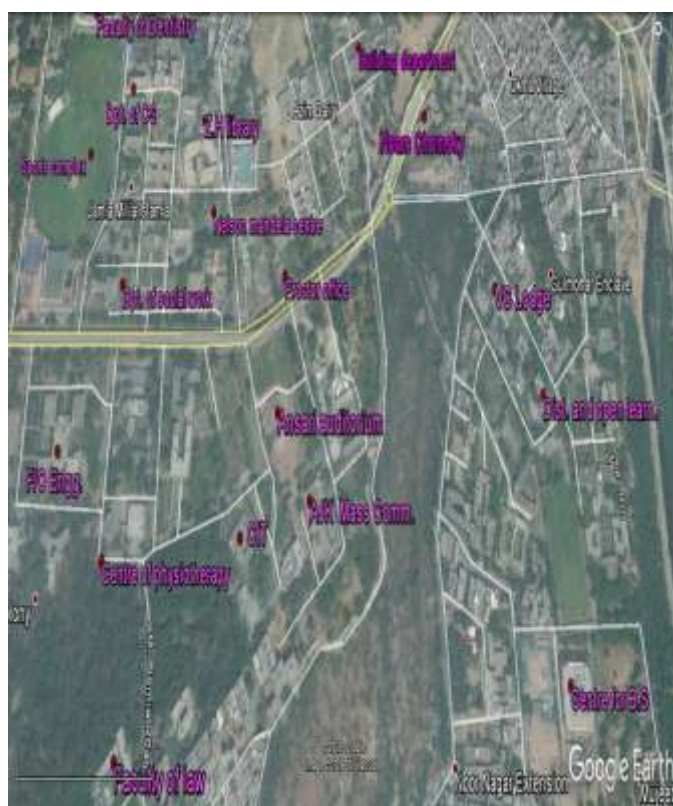


Fig.1. Generator location in the campus

**B. DATA COLLECTION OF DIESEL GENERATORS**

Following list is showing fuel consumption @ 75% load (liters/hour) and actual installation place of 10 numbers of generators out of 40 along with their Geographical locations.

Sr. No	KV A	No.	Fuel consumption @ 75% load (lt/hr)*	Place of Installation	Co-ordinates x, y (m)	
					x	Y
	-	-	-	Main gate of F/O Engg.	0	0
1	125	01	20	Registrar Office	600	-70
2	140	01	22	Jamana L Bajaj House Admin	636	-77
3	125	01	20	Middle School	460	266
4	250	01	42.6	Ansari Auditorium	518	-55
5	200	01	34.4	Main Building MCRC	620	-80
6	150	01	25	Studio Main Building MCRC	620	-80
7	63	01	11.5	Old Studio Building MCRC	620	-80
8	160	01	27.7	Bio-Science Building	620	-80
9	100	01	16.9	Department of Chemistry	620	-80
10	50	01	8.0	Examination Branch	650	-70

Table 1-10 generator locations

In total there are around 40 diesel Generators sets installed in different departments of the University varying from 15KVA to 1250 KVA. Fuel consumption data is based on diesel having specific Gravity of 0.85 and conforming to IS: 1460:2005. In this study we have considered generator operation time only 1 hr. in a day and 300 hrs in a year for the pollutants emission calculations. Total consumption of all Gensets is 1432.2 lt/hr(378.38 gal/hr).

**III. AIR QUALITY MODELING**

Ambient concentration levels of PM10, SOx and NOx have been predicted in winter season using the Industrial Source Complex Short Term (ISCST3) model. The ISCST3 model is based on a steady-state Gaussian plume algorithm, and is



applicable for estimating ambient impacts from point, area, and volume sources out to a distance of about 50 kilometers.

$$= \frac{0.045 \times \text{Dieselgenerator capacity in Hp}}{3600}$$

**A. Modeling Requisite**

[1][2][5]

**Characteristics of different Gensets :**

Installed generator characteristics have been shown under which includes, stack height, exit temperature of flue gas, exit velocity and exhaust diameter of generator. Out of 40 generators only 10 have been represented in the table.

Table 2- Genset data required for model run [3] [4]

Genset No.	KV A	Stack Height (HS), m	Exit Temp (Ts) (K)	Exit Velocity (Vs), m/s	Exhaust Dia (Ds), mm
1	125	22	600	6	115
2	140	22	600	8	165
3	125	22	600	6	115
4	250	25	700	10	200
5	200	25	650	10	180
6	150	22	600	8	165
7	63	20	550	5	90
8	160	22	650	8	165
9	100	20	550	6	115
10	50	20	550	5	90

Table 3 - Fuel consumption and emission rates of 10 Gensets [1] [2]

S. No.	Ratin g (hp)	Fuel intake (l/hr)	Sox Emiss. Rate Qs (g/sec)	NOx Emiss. Rate Qs (g/sec)	PM10 Emiss. Rate Qs (g/sec)	CO Emiss. Rate Qs (g/sec)
1	142.38	20	0.047	0.152	0.009	0.045
2	159.46	22	0.052	0.171	0.011	0.051
3	142.38	20	0.047	0.152	0.009	0.045
4	284.75	42.6	0.101	0.289	0.015	0.078
5	227.80	34.4	0.081	0.231	0.015	0.062
6	170.85	25	0.059	0.183	0.011	0.055
7	71.76	11.5	0.027	0.079	0.008	0.044
8	182.24	27.7	0.065	0.185	0.010	0.050
9	113.90	16.9	0.040	0.122	0.008	0.036
10	56.95	8	0.019	0.063	0.006	0.035

**Fuel consumption and emission rates for different Gensets :**

The Emission rate calculation has been shown below:

**Emission rate for SOx in g/s**

$$= \frac{\text{Fuel consumption rate} \times \text{Density of diesel} \times 1000 \text{grams}}{1800}$$

**Emission rate for NOx in g/s**

$$= \frac{3.85 \times \text{Dieselgenerator capacity in Hp}}{3600}$$

**Emission rate for PM10 in g/s**

$$= \frac{0.24 \times \text{Dieselgenerator capacity in Hp}}{3600}$$

**Emission rate for CO in g/s**

**IV. MODEL RUN**

Data required for model run for predicting is:

(i) Source data: physical dimensions (stack location, stack height, stack top inner diameter), as well as exit velocity and temperature of gas and pollutant emission rate,

(ii) Hourly meteorological data for the simulation period: wind speed, wind direction, ambient temperature, stability class and mixing height and

(iii) Receptor data: receptor coordinates and height of receptor

The Prediction result for CO by ISCST3 model after inputting all the required parameters has been shown in figure 1 below





**	SRCID	QS	HS	TS	VS	DS	
50	SRCPARAM	GENSET1	0.045	22	600.0	06.0	0.115
50	SRCPARAM	GENSET2	0.051	22	600.0	08.0	0.165
50	SRCPARAM	GENSET3	0.045	22	600.0	06.0	0.115
50	SRCPARAM	GENSET4	0.078	25	700.0	10.0	0.200
50	SRCPARAM	GENSET5	0.062	25	650.0	10.0	0.180
50	SRCPARAM	GENSET6	0.055	22	600.0	08.0	0.165
50	SRCPARAM	GENSET7	0.044	20	550.0	05.0	0.090
50	SRCPARAM	GENSET8	0.050	22	650.0	08.0	0.165
50	SRCPARAM	GENSET9	0.036	20	550.0	06.0	0.115
50	SRCPARAM	GENSET10	0.035	20	550.0	05.0	0.090
50	SRCPARAM	GENSET11	0.051	22	600.0	08.0	0.165
50	SRCPARAM	GENSET12	0.131	26	900.0	15.0	0.200
50	SRCPARAM	GENSET13	0.051	22	600.0	08.0	0.165
50	SRCPARAM	GENSET14	0.078	25	700.0	10.0	0.200
50	SRCPARAM	GENSET15	0.045	22	600.0	06.0	0.115
50	SRCPARAM	GENSET16	0.051	22	600.0	08.0	0.165
50	SRCPARAM	GENSET17	0.045	22	600.0	06.0	0.115
50	SRCPARAM	GENSET18	0.043	20	550.0	05.0	0.090
50	SRCPARAM	GENSET19	0.050	22	650.0	08.0	0.165
50	SRCPARAM	GENSET20	0.062	25	650.0	10.0	0.180
50	SRCPARAM	GENSET21	0.051	22	600.0	08.0	0.165
50	SRCPARAM	GENSET22	0.045	22	600.0	06.0	0.115
50	SRCPARAM	GENSET23	0.045	22	600.0	06.0	0.115
50	SRCPARAM	GENSET24	0.078	25	700.0	10.0	0.200
50	SRCPARAM	GENSET25	0.301	35	1020.0	45.0	0.300
50	SRCPARAM	GENSET26	0.078	25	700.0	10.0	0.200
50	SRCPARAM	GENSET27	0.045	22	600.0	06.0	0.115
50	SRCPARAM	GENSET28	0.172	28	900.0	19.0	0.200
50	SRCPARAM	GENSET29	0.172	29	900.0	19.0	0.200
50	SRCPARAM	GENSET30	0.180	30	1000.0	40.0	0.250
50	SRCPARAM	GENSET31	0.172	28	900.0	19.0	0.200
50	SRCPARAM	GENSET32	0.078	25	700.0	10.0	0.200
50	SRCPARAM	GENSET33	0.036	22	600.0	06.0	0.115
50	SRCPARAM	GENSET34	0.021	20	550.0	03.0	0.075
50	SRCPARAM	GENSET35	0.010	20	550.0	03.0	0.075
50	SRCPARAM	GENSET36	0.180	30	1000.0	40.0	0.250
50	SRCPARAM	GENSET37	0.180	30	1000.0	40.0	0.250
50	SRCPARAM	GENSET38	0.078	25	700.0	10.0	0.200
50	SRCPARAM	GENSET39	0.051	22	600.0	08.0	0.165
50	SRCPARAM	GENSET40	0.010	20	550.0	03.0	0.075
50	EMISUNIT	1.0E+06	GRAMS/SEC	MICROGRAMS/M**3			

Fig. 2. ISCST3 model run for CO

## V. RESULT

The ground level pollutants concentrations of PM10, SOx, NOx & CO for this study were predicted through ISCST3 model. The maximum values of average predicted PM10, SOx, NOx and CO concentrations have been shown in table 4 below.

Table4-Predicted and monitored values in comparison to NAAQS

S. no.	Air quality parameters	Time weighted average	Max predicted values, (µg/m <sup>3</sup> )	Monitored values (µg/m <sup>3</sup> )	NAAQS, (µg/m <sup>3</sup> )
1	PM10	24 hr	11.33	392	100
2	SOx	24 hr	58.40	18.7	80
3	NOx	24 hr	176.50	57.8	80
4	CO	8 hr	57.02	1140	2000

The maximum value for PM10 concentration has been observed as 11.33 µg/m<sup>3</sup> at the receptor location (800.00, 0.00, and 0.00). In fact, the predicted PM10 value when compared with the standard value of 24 hourly PM10 concentration prescribed by the CPCB was found to be much lower. The predicted ground level SOx concentration of 58.37 µg/m<sup>3</sup> was observed which was found to be within the CPCB standard/limits of 80 µg/m<sup>3</sup>. Finally the predicted maximum value of 176.49 µg/m<sup>3</sup> was simulated for NOx and the value exceeded the CPCB standard/limits of 80 µg/m<sup>3</sup> for the residential area. The comparison between observed and simulated data has been shown in figure below.

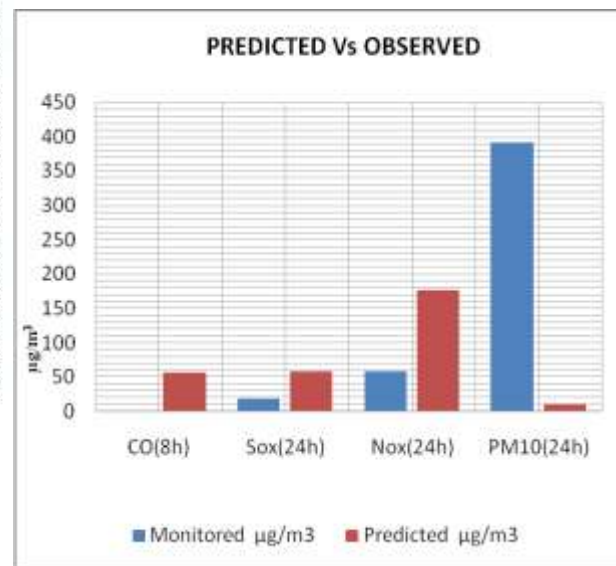


Fig.3. Comparison of predicted and observed data

## VI. CONCLUSION

ISCST3 and local meteorological data were used to predict the concentration of major air pollutants in the campus area. Our findings indicate that after the implementation of the proposed project, concentrations of air pollutant are found to be well below the permissible CPCB Standards for ambient air quality. However, the PM concentration is elevated due to the Construction, traffic and diesel generators implementing proper Environmental Management Plan along with mitigation measures like Water sprinklers, and trees planting, around the industrial area can minimize the pollution and protect the environment from the adverse effects.

## VII. RECOMMENDATIONS

We can install 4 Gensets having capacity 2500 kVA, instead of 40 Gensets of 8650 kVA capacity, the pollutants



concentration will be reduced nearly half of their previous concentration value for PM<sub>10</sub>, SO<sub>x</sub> & CO.

Table5 - Comparison between 40 Gensets Conc. & recommended 4 Gensets Concentration

S. No.	Air quality parameters	Time weighted average	Conc. from 40 Gensets (8650kva), µg/m <sup>3</sup>	Conc. from 4 Gensets(2500 kvaX4), µg/m <sup>3</sup>
1	PM10	24 hr	11.33	4.41
2	SO <sub>x</sub>	24 hr	58.4	26.47
3	NO <sub>x</sub>	24 hr	176.5	166.56
4	CO	8 hr	57.02	16.2

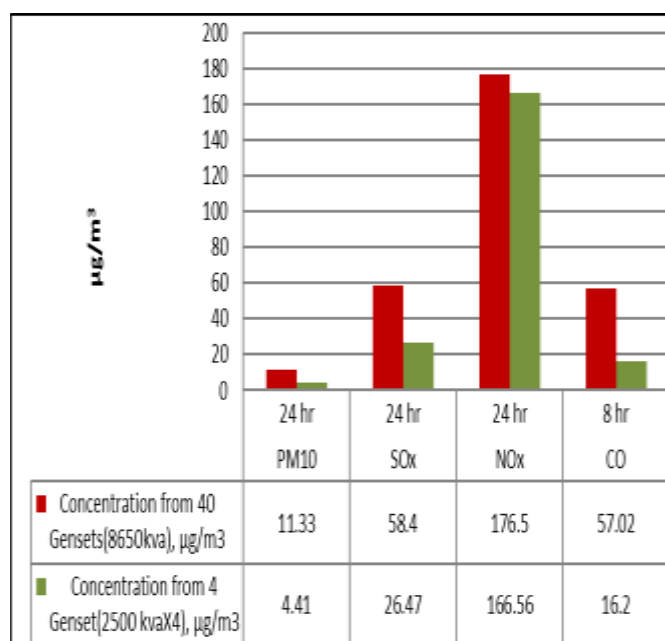


Fig.4. 40 Gensets Concentration Vs. 4 Gensets Concentration

The recommendations so made will assist in improving the air quality scenario around the campus, their prior implementation will decrease load on generators running in and around the campus which will further improve the surrounding air quality.

## VIII. REFERENCE

- [1] "Potential to emit workbook ", Michigan department of Environmental quality USA, Sept 2015
- [2] Air Emission Calculations & Methodology, Virginia offshore wind technology advancement project, Dec 2013
- [3] <http://koel.kirloskar.com/gensets> , Diesel Generator Technical Specification , Kirloskar Electric Co. Ltd., 2015
- [4] Electric Power Application, Engine & Generator Sizing, application and installation guide, Caterpillar, 2008
- [5] Air Pollutants Emission Estimation for the Port of Long Beach Administration Building and Maintenance Facility Project, USA, 2007.
- [6] S gulia, A kumar and M khare, Performance evaluation of calpuff and aermod dispersion models for air quality assessment of an industrial complex, Journal of scientific and industrial research 2015.
- [7] M.S.Priyanka, R.K. Gaurav, Jahnvi.B, Dr.G.D. Ram, Prediction of PM, SO<sub>2</sub> & NO<sub>x</sub> - GLC'S from Point Source Emissions Using Air Modeling , International Journal of Scientific & Engineering Research, 2013.
- [8] NEERI Nagpur, Air quality monitoring, emission inventory and source apportionment studies for Delhi, 2008
- [9] Niyi Awofeso, "Generator Diesel Exhaust: a Major Hazard to Health and the Environment in Nigeria", 2011
- [10] <http://www.equinoxlab.com/d-g-emission-monitoring/>, equinox labs
- [11] Gooie Bee, Ooi Chee, Koh Hock, Lee Hooi, "Modeling inner city traffic generated air pollution", Investing in innovation, 2003
- [12] Darko Koracin , Domagoj Podnar , Judith Chow , Vlad Isakov , Yayi Dong , Alison Miller & Mike McGown, "PM10 Dispersion Modeling for Treasure Valley, Idaho , 2011.
- [13] Sudarsanam Padam, Sanjay K. Singh , "urbanization and urban transport in india the sketch for a policy", 2001.
- [14] <https://www.ft.com/content>, pollution in India: gasping for air, Nov 2015.
- [15] [https://www.envirotechonline.com/article/airmonitoring/6/abhishek\\_mishra/assessment\\_of\\_nox\\_pollution\\_over\\_megacity\\_delhi/2036](https://www.envirotechonline.com/article/airmonitoring/6/abhishek_mishra/assessment_of_nox_pollution_over_megacity_delhi/2036).



[16] Mukesh Sharma “Comprehensive Study on Air Pollution and Green House Gases (GHGs) in Delhi”, Indian Institute of Technology Kanpur, 2016