



IJEAST

INTERNATIONAL JOURNAL
OF ENGINEERING APPLIED SCIENCE
AND TECHNOLOGY



**VOLUME : Vol. ISSUE : 02 Print / Issue Publication Date: 09-Sep-2024
9, Issue 02**



ISSN : 2455-2143



DOI : 10.33564/IJEAST.2024.v09i02.007

Indexed In



WWW.IJEAST.COM

editor@ijeast.com



QUANTIFYING THE WATER LOSS: A CASE STUDY USING EPANET SIMULATION

Jangam Shiva Hari, Pothuganti Praveen Chari
Department of Civil Engineering
JNTU Hyderabad, Kukatpally, Telangana, India

Abstract— This paper centers on the crucial task of water distribution following the treatment process, with a focus on utilizing EPANET software to address challenges in distribution networks. Water distribution systems are vital for delivering water efficiently and reliably to communities. However, leaks within these systems pose significant challenges, resulting in economic losses and environmental concerns. The paper presents a comprehensive literature review on leak assessment methodologies using EPANET, a widely used hydraulic and water quality modeling software. The review includes studies on leak detection, localization, and assessment within the EPANET framework. The introduction emphasizes the importance of managing leaks in water distribution systems, highlighting their economic and environmental impacts. It is followed by a detailed discussion of EPANET's capabilities in modeling pipe networks, flow rates, and pressure—critical parameters for effective leak assessment. Additionally, various leak detection techniques, including pressure-based methods, acoustic methods, and water quality monitoring, are explored within the context of EPANET.

Keywords— EPANET, Simulation, Water Loss

I. INTRODUCTION

Water distribution networks are essential for supplying water to communities, handling high demand through a system of pipelines, tanks, reservoirs, pumps, and valves. These networks must maintain positive pressure to ensure water reaches all areas effectively. Pumps, often sourcing water from rivers like the Krishna and Godavari, pressurize the water as it enters storage tanks located at the highest points in the network. Planning and designing these networks involve civil engineers and city planners, who consider factors such as reservoir location, elevation, current and future water demand, leakage, pressure head, pipe size, pressure loss, and fire fighting flows. Tools like EPANET software are used for pipe network analysis to ensure adequate pressure and flow. Maintaining water quality is crucial as it moves through the system. Corrosion in metal pipes can cause metals to leach into the water, posing health risks. Disinfectants like sodium hypochlorite or monochloramines are added to ensure safe drinking water, with booster stations positioned throughout the

network to maintain proper disinfection levels. Effective water distribution is vital for public health and urban planning.

OBJECTIVES OF THE PRESENT STUDY:

The present study is planned for EPANET software with the following objectives in the view of future demand of the people present in Bandakunta,

1. To design the water distribution network using EPANET software of study area.
2. To simulate possibility of leakages in water distribution system by emitter coefficients.

II. REVIEW OF LITERATURE

According to Silvia Meniconi, Bruno Brunone, Kobus van Zyl, Elisa Mazzetti, and colleagues (2017), equilibrium competition is a simple technique for understanding water distribution and supply. The Aqualibrium network, which aims to evenly divide a given volume among three reservoirs located at three nodes on a grid of sixteen nodes, was simulated using EPANET. However, the simulation results showed discrepancies compared to laboratory tests, particularly under specific flow conditions. The simulation is conducted in two phases: the first phase involves guiding and assessing the flow distribution network without considering local head losses, while the second phase incorporates local head losses into the analysis.

In EPANET, the Darcy-Weisbach formula is used to compute friction losses, accounting for energy dissipation through local head losses and friction. It is important to investigate the differences between numerical simulations using EPANET and laboratory results. Two significant factors that could contribute to these discrepancies are: (i) the assessment of local head losses and (ii) the impact of errors in the extended period simulation approach.

As stated by Diogo Moreira da Costa (2008) in "Simulation of Contaminant Concentrations in Drinking-Water Distribution Systems," the primary goal of this work is to develop software tools for evaluating contaminant concentrations in drinking-water distribution systems. To achieve this, a software application was created by integrating Visual Basic for Applications (VBA) code with EPANET software. This combined tool is designed to perform the necessary calculations for assessing contaminant levels throughout the distribution network.



MODEL NETWORK:

The model network provides information about the various physical objective parameters in EPANET. It provides an overview of the computational techniques used by EPANET to simulate the behavior of hydraulic systems and water quality.

Pipes :

The closed conduits called pipes are used in the network to move water from one location to another. All pipes are assumed by EPANET to be completely filled with water at all times. From higher hydraulic head to lower hydraulic head is the direction of flow.

The diameter, start, end, roughness coefficient, and length are the input parameters. Flow rate, velocity, head loss, Darcy-Weisbach friction factor, average reaction rate, and average water quality are among the computed outputs. The three different formulas below can be used to calculate the hydraulic head loss that is observed in a pipe as a result of friction with the pipe walls.

- Hazen-Williams formula
- Darcy-Weisbach formula
- Chezy-Manning formula

Table -1 Pipe head loss formulae for full flow

| Formula | Resistance Coefficient | Flow Exponent |
|----------------|------------------------------------|---------------|
| | (A) | (B) |
| Hazen-Williams | $4.727 C^{-1.852} d^{-4.871} L$ | 1.852 |
| Darcy-Weisbach | $0.0252 f(\square, d, q) d^{-5} L$ | 2 |
| Chezy-Manning | $4.66 n^2 d^{-5.33} L$ | 2 |

Where C = Hazen-Williams roughness coefficient shown in below Table 1.

ϵ = Darcy-Weisbach roughness coefficient (ft)

f = friction factor (dependent on ϵ , d, and q)

n = Manning roughness coefficient

d = pipe diameter (ft)

L = pipe length (ft)

q = flow rate (cfs)

The Hazen-Williams formula is the head loss formula that is most frequently used in the US. However, it was designed for turbulent flow and is limited to use with water. For all liquids, the most theoretically used formula is the Darcy-Weisbach formula. It is applicable to all liquids and all flow regimes. For open channel flow, the Chezy-Manning formula is typically utilized.

The head loss formula in between start and end point of the pipe line network is

$$h_1 = Aq^B$$

Where A = Resistance Coefficient

B= Flow Exponent are shown in the above Table 1

Table -2 Roughness coefficient for new pipe.

| Material | Hazen-Williams C (unit less) | Darcy-Weisbach e (feet x 10 ⁻³) | Manning's n (unit less) |
|----------------------------|------------------------------|---|-------------------------|
| Cast Iron | 130 – 14 | 0.85 | 0.012 - 0.015 |
| Concrete or Concrete Lined | 120 – 140 | 1.0 – 10 | 0.012 - 0.017 |
| Galvanized Iron | 120 | 0.5 | 0.015 - 0.017 |
| Plastic | 140 – 150 | 0.005 | 0.011 - 0.015 |
| Steel | 140 – 150 | 0.15 | 0.015 - 0.017 |
| Vitrified Clay | 110 | - | 0.013 - 0.015 |

Viewing The Results:

Graph result:

Graphs can be used to view analysis results as well as other factors. Graphs can be printed after being copied to the Windows clipboard, saved as a data file, or saved as a Windows metafile. The graphs can be accessed by selecting the button found in the standard toolbar or by selecting "open report and select graph." To create a graph, click OK.

Table result:

The results for the chosen project are obtained in tabular format. All of the attributes and outcomes for every node or link at a given point in time are included in a network table and time series table. Tables can be saved to a file and printed, or they can be copied to the Windows clipboard. To generate a table, either click the button located in the Standard Toolbar or select "View and select Table".

Print:

In order to print the current project that is displayed in the "go to file" window, first check the print setup and enter the appropriate margins. Next, choose Print Preview, and lastly click Print. You can also print by selecting the button located in the menu toolbar.

Step by step data execution process in loading of Google map to EPANET software

Open Google earth



Open tools then select navigation bar



Remove the side status bar

↓

Add place mark

↓

Note down the North-East coordinates

↓

Go to tools and make sure that all dimensions are in meters

↓

Length and width values are obtained in meters

↓

Write the calculated coordinates in respective places in ---tool as

Upper right: East + length/2

North + width/2

Lower left: East + length/2

North + width/2

↓

Finally Save image in JPEG format

Open JPEG saved file and convert in to BMP picture file & save it by opening in paint

↓

Open EPANET

↓

Go to view, backdrop

↓

Go to Load and open BMP file

↓

Set dimensions in meters and draw the network

Flow chart of EPANET software

Open EPANET software

↓

Create the new project by clicking new option which is present at menu bar

↓

Open the default setting, assign the proper properties and labels, and create the network layout on the EPANET network map.

↓

Add reservoir and nodes with the respective elevation at required places

↓

Connect the nodes with link and add check valves

↓

Give base demand value at each and every node

↓

Give the required values and run the project

↓

Run the network

↓

Save the project

↓

If the project run was successful then get the legends of parameters of discharge, velocity and head loss

↓

Get the report as table and graph of required hydraulic parameters.

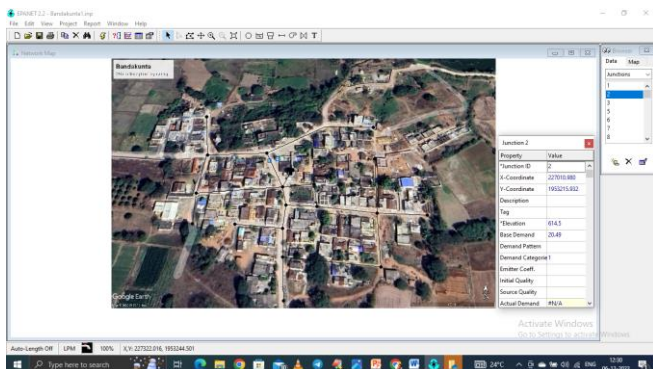


Fig. 3. Google map to EPANET software

As seen in Fig. 3, the network is drawn in EPANET using a Google map.

Collection Of The Data:

In order to carry out the simulation and analysis of Bandakunta locality, the following records were obtained from various sources.

Population data:

Currently, 4150 people live in the Bandakunta area. Hyderabad is a city that is expanding quickly, so the geometric method is used to predict the future population. Accordingly, there will be 13,750 people living in 2024, and that number will rise to 33,880 by 2048. Rate of population growth: 2.92%. The HMWS division office and the census department provided the population data. The population's fluctuations between 1981 and 2011

Quantity of water:

The average amount of water delivered from Bandakunta to Medchal is detailed in the data above. To meet the domestic needs of the 4,750-person Bandakunta area, the geometric population forecast method estimates a requirement of 1.9125

MLD (million liters per day), based on an average daily demand of 150 liters per capita.

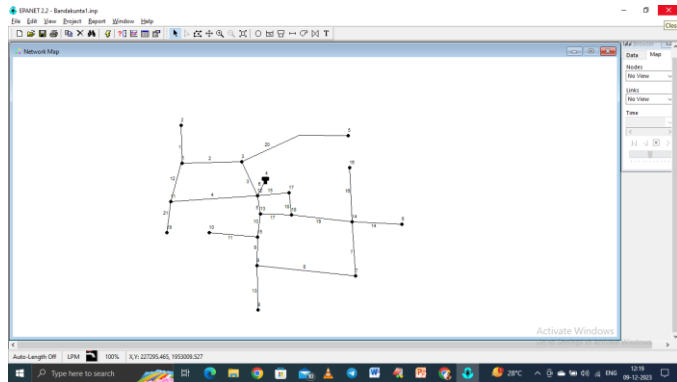


Fig. 4. Layout of Bandakunta

IV.RESULTS AND DISCUSSION

The EPANET results obtained from the software by giving the all required parameters in the form of tables.

Link – Node:

The input values are of link id, pipe length, elevation head, and demand and pipe diameter shown in table

Link - Node Table:

| Link ID | Start Node | End Node | Length m | Diameter mm |
|---------|------------|----------|----------|-------------|
| 1 | 1 | 2 | 60 | 100 |
| 2 | 3 | 1 | 75 | 100 |
| 3 | 12 | 3 | 55 | 200 |
| 4 | 12 | 11 | 105 | 100 |
| 5 | 12 | 13 | 35 | 200 |
| 7 | 7 | 14 | 65 | 100 |
| 8 | 9 | 7 | 120 | 100 |
| 9 | 15 | 9 | 35 | 100 |
| 10 | 13 | 15 | 65 | 200 |
| 11 | 15 | 10 | 45 | 100 |
| 12 | 11 | 1 | 65 | 100 |
| 14 | 14 | 6 | 65 | 100 |
| 15 | 12 | 17 | 35 | 100 |
| 16 | 14 | 16 | 105 | 100 |
| 17 | 13 | 18 | 35 | 100 |
| 18 | 17 | 18 | 25 | 100 |
| 19 | 18 | 14 | 75 | 100 |
| 20 | 3 | 5 | 150 | 100 |
| 21 | 11 | 19 | 50 | 100 |
| 6 | 12 | 4 | 37 | 300 |
| 13 | 9 | 8 | 55 | 100 |

Node Results

Node Results:

| Node | Demand | Head | Pressure | Quality |
|------|--------|------|----------|---------|
|------|--------|------|----------|---------|

| ID | LPM | m | m | |
|----|---------|--------|-------|-----------|
| 1 | 14.98 | 636.49 | 21.49 | 0.00 |
| 2 | 20.49 | 636.49 | 21.99 | 0.00 |
| 3 | 17.30 | 636.50 | 22.00 | 0.00 |
| 5 | 17.31 | 636.49 | 21.99 | 0.00 |
| 6 | 17.39 | 636.48 | 21.98 | 0.00 |
| 7 | 17.39 | 636.48 | 21.98 | 0.00 |
| 8 | 10.74 | 636.49 | 22.89 | 0.00 |
| 9 | 10.86 | 636.49 | 22.89 | 0.00 |
| 10 | 10.90 | 636.50 | 22.90 | 0.00 |
| 11 | 10.62 | 636.49 | 22.89 | 0.00 |
| 12 | 10.86 | 636.50 | 22.90 | 0.00 |
| 13 | 10.90 | 636.50 | 22.90 | 0.00 |
| 14 | 10.86 | 636.48 | 24.48 | 0.00 |
| 15 | 10.90 | 636.50 | 22.90 | 0.00 |
| 16 | 10.86 | 636.48 | 22.88 | 0.00 |
| 17 | 10.90 | 636.50 | 24.50 | 0.00 |
| 18 | 10.62 | 636.49 | 22.89 | 0.00 |
| 19 | 10.86 | 636.49 | 24.49 | 0.00 |
| 4 | -234.74 | 636.50 | 11.50 | 0.00 Tank |

Link Results:

| Link ID | Flow LPM | Velocity m/s | Unit Headloss m/km | Status |
|---------|----------|--------------|--------------------|--------|
| 1 | 20.49 | 0.04 | 0.06 | Open |
| 2 | 30.52 | 0.06 | 0.12 | Open |
| 3 | 65.13 | 0.03 | 0.02 | Open |
| 4 | 26.43 | 0.06 | 0.10 | Open |
| 5 | 103.18 | 0.05 | 0.04 | Open |
| 7 | 3.22 | 0.01 | 0.00 | Open |
| 8 | 20.61 | 0.04 | 0.06 | Open |
| 9 | 42.21 | 0.09 | 0.23 | Open |
| 10 | 64.01 | 0.03 | 0.02 | Open |
| 11 | 10.90 | 0.02 | 0.02 | Open |
| 12 | 4.95 | 0.01 | 0.00 | Open |
| 14 | 17.39 | 0.04 | 0.04 | Open |
| 15 | 29.14 | 0.06 | 0.11 | Open |
| 16 | 10.86 | 0.02 | 0.02 | Open |
| 17 | 28.26 | 0.06 | 0.11 | Open |
| 18 | 18.24 | 0.04 | 0.05 | Open |
| 19 | 35.89 | 0.08 | 0.17 | Open |
| 20 | 17.31 | 0.04 | 0.04 | Open |
| 21 | 10.86 | 0.02 | 0.02 | Open |
| 6 | -234.74 | 0.06 | 0.03 | Open |
| 13 | 10.74 | 0.02 | 0.02 | Open |

Leak assessment in EPANET software:

Emitter Coefficient:

Emitter Coefficient can be used to simulate leaks in pipes that are connected to junctions shown in Fig.6.

Devices called emitters, which are connected to junctions, simulate the flow through an aperture or nozzle that releases gas into the atmosphere.

$$Q = C p^\gamma$$

Where p = pressure,
 C = discharge coefficient,
 γ = pressure exponent, and
 q = flow rate,

Describes how the flow rate through the emitter changes depending on the pressure at the node. γ equals 0.5 for sprinkler heads and nozzles, and the manufacturer typically gives the discharge coefficient value in gpm/psi 0.5

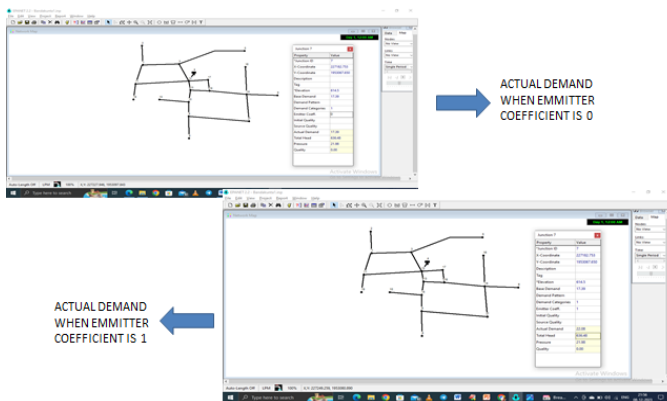


Fig. 5. Emitter Coefficient

Table -3 Actual Demand for Emitter Coefficient

| JUNCTION ID | ACTUAL DEMAND FOR EMMITTER COEFFICIENT (0) | ACTUAL DEMAND FOR EMMITTER COEFFICIENT (1) |
|-------------|--|--|
| 7 | 17.39 | 22.08 |
| 14 | 10.86 | 15.81 |
| 18 | 10.61 | 15.4 |
| 13 | 10.9 | 15.69 |
| 15 | 10.9 | 15.69 |
| 9 | 10.86 | 15.64 |
| 8 | 10.74 | 15.52 |

CALCULATION:

To find velocity in the pipe network use Hazen William's formula

$$V = 0.85 (4)$$

Where, C = Roughness coefficient

R = Hydraulic radius (A/P) for full flowing pipe and for half flowing pipe ($R=d/4$)

A = cross sectional area of pipe

P = Perimeter of the pipe

S = water surface slope (h_f/L)

L = length of given pipe

h_f = elevation difference between respected

nodes.

$$V_1 = 0.85 * 120 * (0.1/4)^{0.63} * (0.02/80)^{0.54}$$

$$V_1 = 0.1 \text{ m/s (at link 7)}$$

$$\text{Similarly } V_2 = 0.022 \text{ m/s (at link 14)}$$

$$V_3 = 0.06 \text{ m/s (at link 15)}$$

$$V_4 = 0.015 \text{ m/s (at link 27)}$$

$$Q = A * V (5)$$

$$Q_1 = 0.78 \text{ lps for the pipe of diameter 200mm.}$$

$$\text{Similarly } Q_2 = 1.7 \text{ lps}$$

$$Q_3 = 0.47 \text{ lps}$$

$$Q_4 = 3 \text{ lps}$$

The major head loss due to friction present in the pipe. The frictional head loss in the network can be calculated by using following formula (6)

Where f = friction factor

l = length of the conveyance pipe

g = acceleration due to gravity

d = diameter of the pipe

v = velocity in pipe.

$$h = flv^2 / (2gd)$$

$$h_1 = (0.03 * 100 * 1^2) / (2 * 9.81 * .1)$$

$$h_1 = 0.015 \text{ m/km}$$

$$\text{Head loss}_1 = 0.06 \text{ m/km (at link 7)}$$

$$\text{Head loss}_2 = 0.95 \text{ m/km (at link 14)}$$

$$\text{Head loss}_3 = 1.15 \text{ m/km (at node 15)}$$

$$\text{Head loss}_4 = 0.185 \text{ m/km (at node 27).}$$

V. CONCLUSION AND RECOMMENDATIONS

CONCLUSION:

1. The salient features of the entire study presented in the paper, the results of EPANET software it is concluded that pressure head & demand at the node and also velocity, discharge and head loss at the link results are within the acceptable range as per HMWS & SB standards and CPHEEO standards.
2. The difference in demand values with emitter coefficients 0 and 1 are obtained at different nodes 7,8, 9, 14, 18, 13 and 15 are 4.69, 4.95, 4.79, 4.77, 4.77, 4.78 and 4.78m³/s respectively

RECOMMENDATION

1. By simulating the EPANET software we can modify the existed pipe diameter with the appropriate pipe diameter in order to get the results.
2. Leak detection is also identified by simulating the network with emitter coefficient and exponent.

REFERENCE

- [1] Annelies De Corte and Kenneth Sorensen (2004). Optimization of gravity fed water distribution network



- design, Lecture Notes in Computer Science, Springer, (pp. 207-215).
- [2] Shie-YuiLiong and Md. Atiquzzaman (2004). Optimal design of water distribution network using shuffled complex evolution, in *Journal of The Institution of Engineers*, Singapore Vol. 44 Issue 1, (Pg 93-107).
- [3] P. Malleswararao and S. Chandramouli (2011), Reliability based optimal design of a water distribution network for municipal water supply, in *International Journal of Engineering and Technology*, vol. 3, issue 1, (Pg 13-19).
- [4] Shivalingaswami.S, Vijaykumar.H, Nagaraj.S.Patil (2016). Hydraulic modeling of water supply network using EPANET in *International Research Journal of Engineering and Technology (IRJET)*, Volume: 03 Issue: 03, (Pg 1022-1027).
- [5] Silvia Meniconi, Bruno Bruno, Kobus van Zyl, and Elisa Mazzettia (2016). Aqualibrium competition: laboratory data and EPAnet simulation in *ELSEVIER*, Volume 186, (Pg 522-529).
- [6] Govind Patel, Divya Patel, KrunalLakhani, and Darshan Mehta (2004). Study of Water Distribution Network Using EPANET in *International Journal of Advanced Research in Engineering, Science, and Management*, vol. 44, (Pg 01-11).
- [7] Harsh Srivastava and AnupamSinghal (2018). Design and analysis of optimized water distribution network at bits pilani, in *Proceedings of the 3rd World Congress on Civil, Structural, and Environmental Engineering (CSEE'18) Budapest, Hungary (CSEE'18)*, paper no. ICESDP 117, (pp. 01-10).
- [8] Philip R. Page (2015). Smart Optimisation and Sensitivity Analysis in Water Distribution Systems, in *Built Environment, Council for Scientific and Industrial Research, Pretoria, South Africa*, (Pg 01-08).
- [9] A. E. Adeniran and M. A. Oyelowo (2013). An EPANET analysis of water distribution network of university of Lagos, Nigera in *Journal of engineering research*, volume 18, no. 2, (Pg 69-83).
- [10] G. VenkataRamana, Ch V. S. S. Sudheer, and B. Rajasekhar (2015). Network analysis of water distribution system in rural areas using EPANET, in *13th Computer Control for Water Industry Conference, CCWI*, (Pg 496-505).
- [11] Er. Saurabh S. Joshi, Er. Pramod K.Jadhav, Dr. A V. Shivapur, Er. Monali DineshVardam (2022). Design of Software Based Water Distribution System for a Village, in *International Research Journal of Engineering and Technology (IRJET)*, Volume: 09 Issue: 08, (Pg 297-302).
- [12] R. Uma (2015). Design of Water Distribution Network Using Differential Evolution, in *International Journal of Science and Research (IJSR)*, Volume 5 Issue 11, (Pg 1516-1520).
- [13] Alperovits, E. and Shamir, U. (1977). Design of optimal water distribution systems, in *Water Resources Research*, Vol. 13[6], (Pg 885-900).
- [14] Lansey, K.E., Duan, N. and Mays, L.W. (1989). Water Distribution System Design under Uncertainties, in *ASCE J. Water Resources Planning & Management*, 115, No. 5, (Pg 630-644)
- [15] Arjun Kumar, Kankesh Kumar, Bharanidharan B, NehaMatial, EshitaDey, Mahan Singh, Vivek Thakur, Sarit Sharma, Neeraj Malhotra, (2015), "Design of Water Distribution System Using Epanet, in *International Journal of Advanced Research*, Volume 3, Issue 9, (Pg 789 – 812).

IJEAST

INTERNATIONAL JOURNAL
OF ENGINEERING APPLIED SCIENCE
AND TECHNOLOGY

ABOUT IJEAST

International Journal of Engineering Applied Science and Technology (IJEAST) is a peer-reviewed, open access journal that publishes high-quality research papers in the field of Engineering, Applied Science and Technology.

IJEAST aims to provide a platform for researchers, academicians, and professionals to share their innovative ideas, research findings, and practical experiences with the global scientific community.

FOCUS AREAS

- Engineering
- Applied Science
- Technology
- Innovation & Development
- Interdisciplinary Studies



PEER REVIEWED

All submissions are rigorously peer reviewed to ensure quality.



OPEN ACCESS

Free and unrestricted access to research for all.



GLOBAL REACH

Connecting researchers and professionals worldwide.



TIMELY PUBLICATION

We ensure a swift and efficient publication process.



For more information, visit our website

www.ijeast.com



INTERNATIONAL JOURNAL
OF ENGINEERING APPLIED SCIENCE
AND TECHNOLOGY

✉ editor@ijeast.com

🌐 www.ijeast.com

📍 India



2455-2143